



F1FR80 Series
Quick-Response Sprinklers
K-factor 8.0 (115)

Features

- Standard coverage quick-response sprinklers
- Upright and pendent orientations
- Low profile, compact design
- Available in a wide variety of finishes
- Available as Intermediate Level sprinklers

Product Description

Reliable Model F1FR80 series sprinklers are quick-response standard spray automatic fire sprinklers utilizing a sensitive 3mm glass bulb thermal element.

Pendent sprinklers may be installed exposed, or surface mounted using escutcheons such as the Reliable Models B, C, or HB (reference Technical Bulletin 204). When installed recessed, the Model F1FR80 series sprinklers are specifically listed with and may only be installed with listed Reliable recessed escutcheons. Refer to the technical information on the following pages for specific listings for recessed installations and refer to Figure 3 for dimensional information.

When fitted with an approved Reliable water shield, these sprinklers may considered intermediate sprinklers for use in racks, below grated walkways, and other areas where intermediate level sprinklers are required.

Table A provides a summary of the approvals and availability of specific Model F1FR series sprinkler configurations. Additional technical information for each sprinkler model is provided on the following pages.



Model F1FR80
Upright Sprinkler



Model F1FR80 Pendent Sprinkler

Note: Not all versions of the product are shown.

F1FR80 Series Sprinkler Summary					Table A
Sprinkler Model	K-Factor gpm/psi ^{1/2} (lpm/bar ^{1/2})	Max. Working Pressure psi (bar)	Listings & Approvals	Orientation	Sprinkler Identification Number (SIN)
F1FR80	8.0 (115)	175 (12) 250 (17) (cULus only)	cULus, FM, LPCB, VdS, CE, UKCA	Upright	RA6322
				Pendent	RA6312

Model F1FR80 Upright Sprinkler

SIN RA6322

Technical Specifications

Style: Upright
Threads: 3/4" NPT or ISO 7-R3/4
Nominal K-Factor: 8.0 (115)
Max. Working Pressure:
 175 psi (12 bar)
 250 psi (17 bar) (cULus only)

Material Specifications

Thermal Sensor: 3 mm Glass Bulb
Sprinkler Frame: Brass Alloy
Cap: Bronze Alloy
Sealing Washer: Nickel with PTFE
Load Screw: Copper Alloy
Deflector: Brass Alloy

Sprinkler Finishes

(See Table B)

Sensitivity

Quick response

Temperature Ratings

135°F (57°C)
 155°F (68°C)
 175°F (79°C)
 200°F (93°C)
 286°F (141°C)

Guards & Shields

F-1 Guard (cULus, FM)
 F-2 Guard (FM)
 F-3 Guard with Shield (cULus, FM)
 Factory Installed Shield (cULus, FM)

Sprinkler Wrenches

Model W2
 Model W14 (with guard installed)


Listings and Approvals

cULus
 FM
 LPCB
 VdS
 CE
 UKCA: 0832-UKCA-CPR-S5078



Model F1FR80 Upright Sprinkler Components and Dimensions

Figure 1

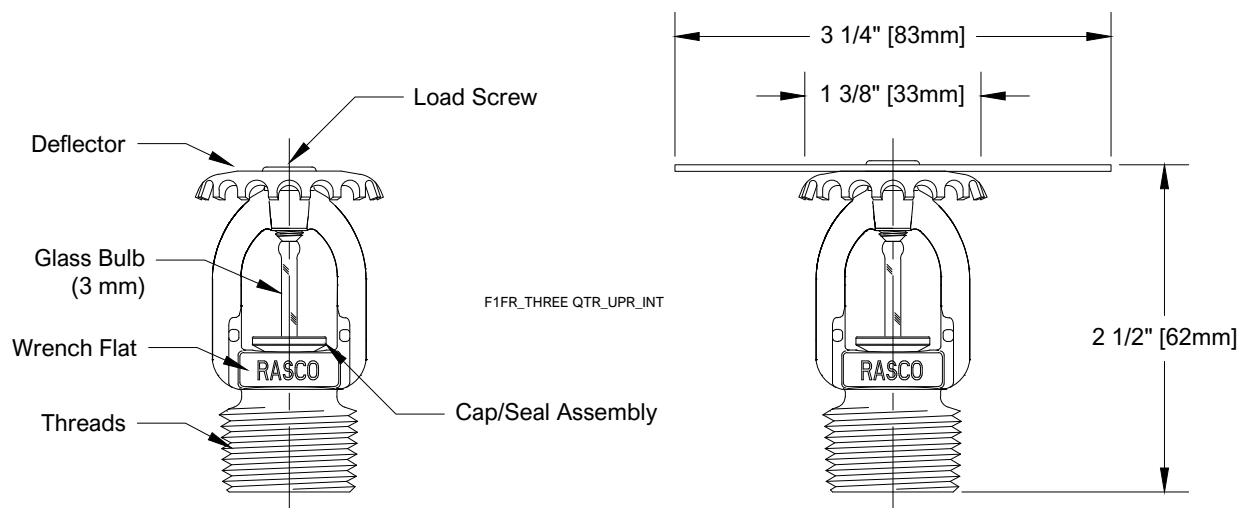

Shown with Optional
 Factory Installed Water Shield
 (Intermediate Upright)

Wrenches



Model W2 (upright, pendent)



Model W14 (with guard installed)



Model W4
(recessed pendent)

Finishes⁽¹⁾

Table B

Standard Finishes		Special Application Finishes	
Sprinkler	F1, F2 and FP ⁽²⁾ Escutcheons	Sprinkler	F1, F2 and FP ⁽²⁾ Escutcheons
Bronze	Brass	Electroless Nickel PTFE ⁽³⁾⁽⁴⁾	Bright Brass
Chrome Plated	Chrome Plated	Bright Brass ⁽⁵⁾	Satin Chrome
White Polyester ⁽³⁾	White Polyester	Satin Chrome	Custom Color Polyester
		Custom Color Polyester ⁽³⁾⁽⁶⁾	

Notes:

1. Paint or any other coating applied over the factory finish will void all approvals and warranties.
2. Model FP escutcheons utilizes a galvanized steel cup with a finished trim ring.
3. cULus Listed as corrosion resistant.
4. FM Approved as corrosion resistant.
5. For 200°F (93°C) maximum temperature rated sprinklers only.
6. cULus Only.

Installation

Model F1FR Series sprinklers must be installed in accordance with NFPA13 and the requirements of all applicable authorities having jurisdiction. Model F1FR Series sprinklers must be installed with the Reliable sprinkler installation wrench identified in this Bulletin. Any other wrench may damage the sprinkler. The Models W2 and W4 wrenches have two sets of jaws. Use the smallest set of jaws that fit on the wrench flats of the sprinkler. A leak tight sprinkler joint can be obtained with a torque of 8 to 18 lb-ft (11 to 24 N-m). Do not tighten sprinklers over the maximum recommended installation torque. Exceeding the maximum recommended installation torque may cause leakage or impairment of the sprinkler.

Glass bulb sprinklers have orange bulb protectors or protective caps to minimize bulb damage during shipping, handling and installation. Reliable sprinkler installation wrenches are designed to install sprinklers with bulb protectors in place. Remove the bulb protector at the time when the sprinkler system is placed in service for fire protection. Removal of the bulb protector before this time may leave the bulb vulnerable to damage. Remove bulb protectors by undoing the clasp by hand. Do not use tools to remove bulb protectors.

Maintenance

Reliable Model F1FR series sprinklers should be inspected and the sprinkler system maintained in accordance with NFPA 25, as well as the requirements of any Authorities Having Jurisdiction.

Prior to installation, sprinklers should remain in the original cartons and packaging until used. This will minimize the potential for damage to sprinklers that could cause improper operation or non-operation.

Do not clean sprinklers with soap and water, ammonia liquid or any other cleaning fluids. Remove dust by gentle vacuuming without touching the sprinkler.

Replace any sprinkler which has been painted (other than factory applied). A stock of spare sprinklers should be maintained to allow quick replacement of damaged or operated sprinklers. Failure to properly maintain sprinklers may result in inadvertent operation or non-operation during a fire event.

Guarantee

For the guarantee, terms, and conditions, visit www.reliablesprinkler.com.

Ordering Information

Specify the following when ordering:

Model

- F1FR80

Deflector/Orientation

- Upright
- Upright Intermediate
- Pendent

Temperature Rating

- See sprinkler technical specifications

Sprinkler Finish

- See Table B

Recessed Escutcheon

- F1
- F2
- FP

Escutcheon Finish

- See Table B

Sprinkler Wrench

- Model W2 (upright and pendent)
- Model W4 (recessed)
- Model W14 (with guard installed)



Sprinklers | Non-Storage Sprinklers | **Non-Storage Sprinklers**

RA6322

Details

Category	Non-Storage Sprinklers
Class of Work	2001 - AS, Ctrl Mode (nom K=8.0)
Approval Standard	FM 2000 - Automatic Sprinklers for Fire Protection
Certification Type	FM Approved
K (metric)	115
Coverage Type	Standard
Sprinkler Category	Non Storage
Use with Vacuum System	No
Grooved Connection	No
K	8.0
Type	Upright
Response	QR - Quick Response
Element	3 mm
NPT (in.)	3/4
Finish	Chrome, Polyester, Electroless Nickel PTFE (ENT), Brass
Temp. Rating (°F)	135, 155, 175, 200, 286
Temp. Rating (°C)	57, 68, 79, 93, 141

Company

Reliable Automatic Sprinkler Co Inc

1470 Smith Grove Rd, Liberty ,
South Carolina 29657-0313
United States of America

<http://reliablesprinkler.com>



Listing Country United States of
America

SIN RA6322

File Number: EX454

COMPANY

RELIABLE AUTOMATIC SPRINKLER CO INC

1470 Smith Grove Rd

Liberty, SC 29657 United States

SIN INFO

RA6322

Glass Bulb Type

ATTRIBUTES				
Response Type	Sprinkler Type	Nom K-Factor, gpm/vpsi (L/min/vbar)	System Working Pressure	Corrosion Resistant
QR	Standard-Spray Sprinklers, Upright And Pendent, Intermediate Level Sprinklers	8.0 (115)	250 psig (1.7 Mpa)	Non-Wax Coatings - See installation instructions

GENERAL	
Inlet Connection	
3/4 in. NPT	

STANDARD-SPRAY SPRINKLERS, UPRIGHT AND PENDENT

Type

Sprinkler Temp Rating, °F (°C)

Cover Temp Rating, °F (°C)

Upright	135 (57), 158 (68), 175 (79), 200 (93), 286 (141)	Not Applicable
---------	---	----------------

Las cookies en UL Solutions

Usamos cookies para personalizar el contenido y los anuncios, para proporcionar funciones de redes sociales y para analizar nuestro tráfico. También compartimos información sobre el uso que usted hace de nuestro sitio web con nuestros socios de redes sociales, publicidad y análisis. [Más información](#)

Configuración de las cookies

Rechazar todas

Aceptar todas las cookies

INTERMEDIATE LEVEL SPRINKLERS

Type	Sprinkler Temp Rating, °F (°C)
Upright	135 (57), 155 (68), 165 (73), 175 (79), 200 (93), 212 (100), 286 (141)

Report Date: 1989-06-16
Revision Date: 2025-04-01

La presencia del nombre de una empresa o producto en esta base de datos no garantiza por sí misma que los productos así identificados hayan sido fabricados bajo el servicio de seguimiento de UL. Solo aquellos productos que lleven la marca UL deben considerarse como certificados y garantizados bajo el servicio de seguimiento de UL. Busque siempre la marca en el producto.

UL permite la reproducción del material contenido en el directorio de certificación en línea sujeta a las siguientes condiciones: 1. La información de la guía, las ensamblajes, las construcciones, los diseños, los sistemas y/o certificaciones (archivos) deben presentarse en su totalidad y de forma no engañosa, sin ninguna manipulación en los datos (o dibujos). 2. Debe aparecer la declaración "Reimpreso desde el directorio de certificaciones en línea con permiso de UL" junto al material extraído. Además, el material reimpreso debe incluir una nota de derechos de autor en el siguiente formato: "©2025 UL LLC."

Las cookies en UL Solutions

Usamos cookies para personalizar el contenido y los anuncios, para proporcionar funciones de redes sociales y para analizar nuestro tráfico. También compartimos información sobre el uso que usted hace de nuestro sitio web con nuestros socios de redes sociales, publicidad y análisis. [Más información](#)



Sprinklers | Non-Storage Sprinklers | **Recessed, Flush, and Concealed Sprinklers**

RA6312

Details

Category	Recessed, Flush, and Concealed Sprinklers
Class of Work	2015 - AS, Ctrl Md, Rec FI & Concl'd
Approval Standard	FM 2000 - Automatic Sprinklers for Fire Protection
Certification Type	FM Approved
K (metric)	115
Coverage Type	Standard
Sprinkler Category	Non Storage
Use with Vacuum System	No
Grooved Connection	No
K	8.0
Type	Recessed Pendent
Response	QR - Quick Response
Element	3 mm
NPT (in.)	3/4
Finish	Brass, Polyester, Chrome, Electroless Nickel PTFE (ENT)
Temp. Rating (°F)	135, 155, 175, 200
Temp. Rating (°C)	57, 68, 79, 93

Company

Reliable Automatic Sprinkler Co Inc

1470 Smith Grove Rd, Liberty ,
South Carolina 29657-0313
United States of America

<http://reliablesprinkler.com>



Listing Country United States of America



SIN RA6312

File Number: EX454

COMPANY

RELIABLE AUTOMATIC SPRINKLER CO INC

1470 Smith Grove Rd
Liberty, SC 29657 United States

SIN INFO

RA6312
Glass Bulb Type

ATTRIBUTES				
Response Type	Sprinkler Type	Nom K-Factor, gpm/vpsi (L/min/vbar)	System Working Pressure	Corrosion Resistant
QR	Standard-Spray Sprinklers, Upright And Pendent	8.0 (115)	250 psig (1.7 Mpa)	Not Available

GENERAL	
Inlet Connection	
3/4 in. NPT	

STANDARD-SPRAY SPRINKLERS, UPRIGHT AND PENDENT		
Type	Sprinkler Temp Rating, °F (°C)	Cover Temp Rating, °F (°C)
Pendent	135 (57), 155 (68), 175 (79), 200 (93), 286 (141)	Not Applicable



La presencia del nombre de una empresa o producto en esta base de datos no garantiza por sí misma que los productos así identificados hayan sido fabricados bajo el servicio de seguimiento de UL. Solo aquellos productos que lleven la marca UL deben considerarse como certificados y garantizados bajo el servicio de seguimiento de UL. Busque siempre la marca en el producto.

UL permite la reproducción del material contenido en el directorio de certificación en línea sujeta a las siguientes condiciones: 1. La información de la guía, las ensamblajes, las construcciones, los diseños, los sistemas y/o certificaciones (archivos) deben presentarse en su totalidad y de forma no engañosa, sin ninguna manipulación en los datos (o dibujos). 2. Debe aparecer la declaración "Reimpreso desde el directorio de certificaciones en línea con permiso de UL" junto al material extraído. Además, el material reimpreso debe incluir una nota de derechos de autor en el siguiente formato: "©2025 UL LLC."